



**Institut de
Tecnologia de la Construcció
de Catalunya**

Wellington 19
ES08018 Barcelona
T +34 933 09 34 04
qualprod@itec.cat
itec.cat



Member of



www.eota.eu

European Technical Assessment

ETA 19/0511
of 04.04.2024



General part

Technical Assessment Body issuing the ETA: ITeC

ITeC has been designated according to Article 29 of Regulation (EU) No 305/2011 and is member of EOTA (European Organisation for Technical Assessment)

**Trade name of the construction
product**

SikaTack® Panel-50

**Product family to which the
construction product belongs**

Adhesives for wall cladding.

Manufacturer

SIKA SERVICES AG

Tueffenwies 16
CH-8048 Zurich
Switzerland

Manufacturing plant(s)

SIKA ENGINEERING SILICONES S.R.L.
Via Einaudi 6
20068 Peschiera Borromeo, Milan
Italy

**This European Technical
Assessment contains**

12 pages including 2 annexes which form an integral part of this assessment.

**This European Technical
Assessment is issued in
accordance with Regulation
(EU) 305/2011, on the basis of**

European Assessment Document EAD 250005-00-0606
Adhesive for wall cladding.

This ETA replaces

ETA 19/0511 issued on 12.11.2019

General comments

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may be made, with the written consent of issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

Specific parts of the European Technical Assessment

1 Technical description of the product

This ETA is applicable to the SikaTack® Panel-50 kit for bonding opaque cladding elements on aluminium alloy subframe in ventilated façades.

The adhesive kit SikaTack® Panel-50 consists of the following components:

- SikaTack® Panel-50 Adhesive: one component silicone-based adhesive. Design characteristics are given in table 1.1.
- SikaTack® Panel Primer: liquid consistency primer for the treatment of surfaces (porous and non-porous).

Other ancillary products for adhesion surface preparation:

- Sika® Aktivator-205: surface pre-treatment and cleaning agent.
- SikaTack® Panel Fixing Tape: double-sided adhesive closed-cell polyethylene spacer tape. This tape is used for the initial bonding of the cladding elements until the complete curing of the SikaTack® Panel-50 Adhesive and to ensure the correct dimensions of the adhesive bead.

Components detailed information and data are given in Annex 1 of this ETA.

Other external wall cladding products (cladding elements, subframe components, thermal insulation, anchors, etc.) are not part of the kit assessed in this ETA.

Table 1.1: SikaTack® Panel-50 Adhesive design characteristics.

Characteristic	Value
Thickness	$e = 3,0 \text{ mm}$
Adhesive bead (bite)	$b \geq 12,0 \text{ mm}$
Maximum design tensile stress	$\sigma_{des} = 0,15 \text{ MPa}$
Maximum design shear stress	$\tau_{des} = 0,012 \text{ MPa}$
Maximum hygrothermal displacement in dynamic shear	$\Delta L_{s,des} = 1,35 \text{ mm}$

2 Specification of the intended use(s) in accordance with the applicable European Assessment Document (hereinafter EAD)

The SikaTack® Panel-50 kit is intended for bonding opaque cladding elements on aluminium alloy subframes with vertical profiles in ventilated façades (rainscreens). Substrate materials intended to be used with SikaTack® Panel-50 kit are given in table 2.1.

Table 2.1: Substrate materials.

Generic type of substrate (*)	European technical specification reference
HPL laminates	EN 438-7
Ceramic tiles	EN 14411
TMCP - Thin metal composite panels	EAD 210046-00-1201 & EOTA TR 038
Anodised aluminium and aluminium mill finish	EN 755 & EN 1999-1

(*) Each specific type of substrate material to be used on-site should be verified by means of the peel test according to Annex 2 of EAD 250005-00-0606. Annex 3 of this ETA includes the specific trade name substrate materials accepted by the manufacturer to be used with SikaTack® Panel-50 kit. The assessment of the panels for the use as external wall cladding elements glued to the subframe is not covered, neither by the EAD 250005-00-0606, nor by this ETA.

The provisions made in this European Technical Assessment are based on an assumed working life of at least 25 years for SikaTack® Panel-50 kit. The indications given on the working life cannot be interpreted as a guarantee given by the manufacturer or the assessment body, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

Detailed information and data regarding design, installation, maintenance and repair criteria are given in Annex 2.

3 Performance of the product and reference to the methods used for its assessment

The assessment of SikaTack® Panel-50 kit for the intended use was performed following EAD 250005-00-0606 *Adhesive for wall cladding (March 2018)*.

Table 3.1: Summary of the SikaTack® Panel-50 kit performance (see also detailed performance in relevant sections).

Product:	SikaTack® Panel-50 kit		Intended use:	Bonding opaque cladding elements on aluminium alloy subframes of external wall claddings in ventilated façades (rainscreens).		
Basic Works Requirement	ETA section	Essential characteristic		Performance		
BWR 2 Safety in case of fire	3.1	Reaction to fire		Depending on the cladding element. See section 3.1		
BWR 3 Hygiene, health and the environment	---	Content and/or release of dangerous substances		Not assessed		
BWR 4 Safety and accessibility in use	3.2	Initial mechanical resistance	+ 23 °C	σ _{u,c} = 1,45 MPa		
			+ 80 °C	σ _{u,c} = 1,47 MPa		
			- 20 °C	σ _{u,c} = 1,39 MPa		
	3.3	Residual mechanical resistance	Ageing under temperature and high humidity		σ _{u,c} = 0,97 MPa	
			Immersion in water		σ _{u,c} = 1,31 MPa	
			High humidity and NaCl atmosphere		σ _{u,c} = 1,32 MPa	
			High humidity and SO ₂ atmosphere		σ _{u,c} = 1,00 MPa	
			Mechanical fatigue in tension		σ _{u,c} = 1,12 MPa	
	3.4	Shear under cyclic loading		σ _{u,c} = 1,24 MPa S _{t,m} = 9,7%		
	3.5	Shear creep and climatic ageing		S _{tv,c} = 0,52 mm		
	3.6	Tear resistance		σ _{u,c} = 0,95 MPa		
Durability	3.7	Shrinkage		See table 3.5		
		Gas inclusion		Not relevant		
		Effects of materials in contact		See table 3.5		
		Specific mass				
		Tensile elastic modulus				
		Flow resistance				
		Hardness				
		Thermogravimetric analysis				
Colour						

3.1 Reaction to fire

The reaction to fire of SikaTack® Panel-50 kit has been assessed according to section 2.2.2 of EAD 250005-00-0606.

The reaction to fire of SikaTack® Panel-50 kit depends on the specific cladding element. See table 3.2 for the reaction to fire according to Commission Delegated Regulation (EU) 2016/34 and EN 13501-1.

For other cladding elements, reaction to fire of SikaTack® Panel-50 kit has not been assessed.

Table 3.2: Reaction to fire depending on the specific cladding element materials.

Generic cladding element material	Specific cladding element	Reaction to fire class
Ceramic tile	Laminam®	B-s2,d2
TMCP	Alucobond® A2	B-s2,d2

Note: A European reference fire scenario has not been laid down for façades. In some Member States, the classification of external wall claddings according to EN 13501-1 might not be sufficient for the use in façades. An additional assessment of external wall claddings according to national provisions (e.g. on the basis of a large-scale test) might be necessary to comply with Member State regulations, until the existing European classification system has been completed.

3.2 Initial mechanical resistance

Initial mechanical resistance has been tested according to section 2.2.4 of EAD 250005-00-0606.

Test results are given in table 3.3.

Table 3.3: SikaTack® Panel-50 mechanical resistance.

Test type		Breaking tensile stress (MPa)		Elongation at break (%)		Ratio	Cohesive rupture (%)
		$\sigma_{u,m}$	$\sigma_{u,c}$	$\epsilon_{u,m}$	$\epsilon_{u,c}$	Δx_m	$C_{r,m}$
Initial	NT	1,55	1,45	283	224	---	100
	HT	1,59	1,47	218	175	1,03	100
	LT	1,51	1,39	269	193	0,97	99
Residual	HT+HR	1,25	0,97	240	188	0,81	96
	H2O	1,39	1,31	261	193	0,90	98
	HR+NaCl	1,51	1,32	261	190	0,97	99
	HR+SO2	1,45	1,00	253	117	0,94	97
	MFT	1,36	1,12	262	183	0,88	97
Shear under cyclic loading (SCL)		1,42	1,24	250	184	0,91	94
Tear Resistance (TR)		1,06	0,95	255	137	0,68	98
Effects of materials in contact		1,33	0,95	229	84	0,85	99

Where:

NT = At normal temperature, +18 °C to +23 °C.

HT = At high temperature, +80 °C ± 1 °C.

LT = At low temperature, -20 °C ± 1 °C.

HT+HR = 1004 ± 4 hours at high temperature, 60 °C ± 2 °C and high relative humidity, 85 ± 2 %.

H₂O = After immersion in water for 7 days at normal temperature.

HR+NaCl = After high humidity and NaCl atmosphere for 480 ± 2 hours.

HR+SO₂ = After high humidity and SO₂ atmosphere.

MFT = After mechanical fatigue in tension.

SCL = Shear under cyclic loading.

TR = Tear Resistance.

m = Mean (average) value.

c = Characteristic value giving 75% confidence that 95% of the test results will be higher than this value.

3.3 Residual mechanical resistance

Residual mechanical resistance has been tested according to section 2.2.5 of EAD 250005-00-0606.

Test results are given in table 3.3.

3.4 Shear under cyclic loading

Shear under cyclic loading has been tested according to section 2.2.6 of EAD 250005-00-0606.

Test results are given in table 3.3. In addition, the obtained value for the stabilization load is $S_{t,m} = 9,7\%$.

3.5 Shear creep and climatic ageing

Shear creep and climatic ageing has been tested according to section 2.2.7 of EAD 250005-00-0606.

Test results are given in table 3.4.

Table 3.4: SikaTack® Panel-50 shear creep results.

Test type		Vertical displacement after 168 ± 4 h (mm)		Vertical displacement after 1004 ± 4 h (mm)		Stabilization of vertical displacement (mm)	
		d1 _m	d1 _c	d2 _m	d2 _c	Stv _m	Stv _c
Shear creep and climatic ageing	HT+HR	0,85	1,19	1,21	1,60	0,36	0,52

Where:

HT+HR = 1004 ± 4 hours at high temperature (60 °C ± 2 °C) and high relative humidity (85 ± 2 %).

m = Mean (average) value.

c = Characteristic value giving 75% confidence that 95% of the test results will be lower than this value.

3.6 Tear resistance

Tear resistance has been tested according to section 2.2.8 of EAD 250005-00-0606.

Test results are given in table 3.3.

3.7 Durability

Relevant durability characteristics of SikaTack® Panel-50 Adhesive have been tested according to section 2.2.9 of EAD 250005-00-0606.

Test results are given in table 3.5.

Table 3.5: SikaTack® Panel-50 Adhesive durability characteristics test results.

Characteristic	Reference	Value
Shrinkage	EN ISO 10563	Change in mass: $\Delta m = - 2,7\%$ (*) Change in volume $\Delta V = - 4,1\%$ (*)
Effects of materials in contact	Section 2.2.9.3 of EAD 250005-00-0606	See table 3.3. No decolouration has been observed
Specific mass	EN ISO 1183-1	1,35 kg/l
Tensile elastic modulus	EN ISO 527-3	2,65 MPa
Flow resistance	EN ISO 7390, method A	No flow
Hardness Shore A	EN ISO 868	41,4
Thermogravimetric analysis	EN ISO 11358-1	Curve kept in ETA technical dossier
Colour	EN ISO 11664-4	Grey

(*) The symbol “-” indicates a decrease of mass or volume.

4 Assessment and verification of constancy of performance (hereinafter AVCP) system applied, with reference to its legal base

According to the decision¹ 1999/470/EC of the European Commission for construction adhesives, as amended by decision² 2001/596/EC of 8 January 2001, the systems of AVCP (see EC delegated regulation (EU) No 568/2014 amending Annex V to Regulation (EU) 305/2011) given in the following table applies.

Table 4.1: Applicable AVPC system.

Product	Intended use(s)	Level(s) or class(es)	AVCP System(s)
Structural adhesives	For uses subject to reaction to fire regulations	See table 3.2	3
	For structural uses in buildings and other civil engineering works	Any	2+

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

All the necessary technical details for the implementation of the AVCP system are laid down in the *Control Plan* deposited with the ITeC³, with which the factory production control shall be in accordance.

Issued in Barcelona on 4th April 2024

by the Catalonia Institute of Construction Technology.



Ferran Bermejo Nualart
Technical Director, ITeC

¹ Official Journal of the European Union (OJEU) L184 of 17/07/1999.

² Official Journal of the European Union (OJEU) L209 of 02/08/2001.

³ The *Control Plan* is a confidential part of the ETA and is only handed over to the notified certification body involved in the assessment and verification of constancy of performance.

ANNEX 1: Components description

Information included in tables A1.1 to A1.4 has been taken from the technical data sheets of the manufacturer.

Table A1.1: SikaTack® Panel-50 Adhesive.

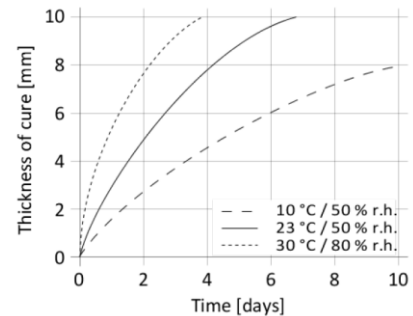
Typical Product Data	Reference	Value
Chemical base	---	1-component silicone
Colour	CQP 001-1	Grey
Cure mechanism	---	Moisture-curing
Density (uncured)	---	1,4 kg/l
Non-sag properties	CQP 061-4 / ISO 7390	Good
Application temperature ambient	---	5 °C to 40 °C
Skin time at 23 °C / 50% RH	CQP 019-1	25 min.
Curing speed	CQP 049-1	
Shore A-hardness	CQP 023-1 / ISO 7619-1	38
Tensile strength	CQP 036-1 / ISO 527	2,1 MPa
Elongation at break	CQP 036-1 / ISO 527	450%
Tear propagation resistance	CQP 045-1 / ISO 34	7 N/mm
Service temperature	---	- 40 °C to 150 °C
Shelf life storage below 25 °C	CQP 016-1	9 months
CQP = Corporate Quality Procedure.		

Table A1.2: SikaTack® Panel Primer.

Typical Product Data	Reference	Value
Chemical base	---	Solvent-based Epoxy solution
Colour	CQP 001-1	Black
Solid content	---	32%
Application temperature	---	5 °C to 40 °C
Application method	---	Brush, felt or foam applicator
Consumption	---	50 ml/m ² approx. (*)
Flash-off time	---	10 min. (≥ 15 °C) 30 min. (< 15 °C) 8 hours (maximum)
Shelf life storage below 25 °C, sealed container in dry place	CQP 016-1	9 months
CQP = Corporate Quality Procedure. (*) Depending on substrate porosity surface.		

Table A1.3: Sika® Aktivator-205.

Typical Product Data	Reference	Value
Chemical base	---	Solvent-based adhesion promoter
Colour	---	Colourless, clear
Application temperature	---	5 °C to 40 °C
Application method	---	Wiping with lint-free paper towel
Consumption	---	20 ml/m ² approx. (*)
Flash-off time at 23 °C / 50% RH (**)	---	Minimum: 10 min. Maximum: 2 hours
Shelf life storage below 25 °C, sealed container in dry place	---	12 months
CQP = Corporate Quality Procedure. (*) Depending on substrate porosity surface. (**) In specific applications, temperature and flash-off time may be different.		

Table A1.4: SikaTack® Panel Fixing Tape.

Typical Product Data	Reference	Value
Chemical base	---	Closed cell polyethylene foam core with pressure sensitive adhesive
Colour	---	Anthracite.
Section dimension	---	3 mm x 12 mm
Density	---	0,064 g/cm ³
Tensile strength	ISO 527	MD: 25 N/15 mm TD: 20 N/15 mm
Elongation at break	ISO 527	MD: 250% TD: 150%
Compressive strength	ISO 844	0,02 N/mm ² (10% deflection) 0,05 N/mm ² (25% deflection) 0,12 N/mm ² (50% deflection)
Peel adhesion	FTM 1	23 N/25 mm (180°, 30 min., stainless steel)
Resistance to shear	FTM 8	150 h (1 kg / 25 mm x 25 mm)
Application temperature	---	5 °C to 35 °C
Service temperature	---	- 40 °C to 70 °C
Shelf life storage below 25 °C, dry and sunlight protected	---	24 months
FTM = FINAT Test Method. MD = Longitudinal direction. TD = Transversal direction.		

ANNEX 2: Design, installation, maintenance and repair criteria

A2.1 Design

The design of the external wall claddings in ventilated façades using SikaTack® Panel-50 kit for bonding the opaque cladding elements on aluminium alloy subframe of vertical profiles should consider:

- Failure of the adhesive bead might cause risk to human life and/or have considerable economic consequences. Therefore, special care should be considered with respect to:
 - The verification of the minimum dimension of the adhesive bead bite, bead length and minimum number of beads by each cladding element by means of calculation, considering the design values given in table 1.1 of this ETA. National safety factors, other national provisions and specific provisions given by the kit manufacturer must be followed.
 - The verification of the adherence on the specific materials (cladding element and subframe profile) to be used on-site (see table 2.1) by means of the peel test (see Annex 2 of EAD 250005-00-0606) in normal conditioning and after ageing.
 - The verification of the specific qualification and training of the SikaTack® Panel-50 kit installer.
- It is assumed that the substrate wall meets the necessary requirements regarding the mechanical strength (resistance to static and dynamic loads) and the airtightness, as well as the relevant resistance regarding watertightness and water vapour.
- The verification of the whole external wall cladding design (including cladding elements, subframe components and anchors to the substrate wall) by means of calculation, considering the mechanical characteristic values of each component in order to resist the actions (dead loads, wind loads, hightemperature loads, etc.) applying on the specific works. National safety factors and other national provisions must be followed.
- The accommodation of the designed system movements to the substrate or structural movements.
- The execution of singular parts of the façade; construction details regarding drainage and ventilation provisions should be considered. Water stagnation is not allowed in the vicinity of the adhesive bead. Therefore, the bonded cladding shall be designed with an efficient drainage and ventilation.
- The corrosion protection of the metallic components taking into account the category of corrosivity of the atmosphere of works (e.g. acc. ISO 9223).
- Because usually the joints are not watertight, the first layer behind ventilated air space (e.g. insulation layer) should be composed by materials with low water absorption.

A2.2 Installation

Installation of the external wall claddings for ventilated façades using SikaTack® Panel-50 kit should be carried out:

- According to the specifications of the manufacturer and using the components specified in this ETA.
- In accordance with the design and drawings prepared for the specific works. The manufacturer should ensure that the information on these provisions is given to those concerned.
- By appropriately qualified staff and under the supervision of the technical responsible of the specific works.
- Components shelf life and storage conditions must be respected (see tables in Annex 1 of this ETA).

A2.3 Maintenance and repair

Maintenance of the external wall claddings for ventilated façades using SikaTack® Panel-50 kit includes inspections on-site, to observe the appearance of any damage as cracking, detachment, delamination, mould presence, corrosion presence or water accumulation due to permanent moisture or permanent irreversible deformation.

When necessary, any repair to localized damaged areas must be carried out with the same components and following the repair instructions given by the manufacturer.

ANNEX 3: List of panels accepted by SIKA SERVICES AG to be used with SikaTack® Panel-50 kit (informative)

Table A3.1 includes the trade name of the panels that have been accepted by Sika Services AG to be used with SikaTack® Panel-50 kit.

This Sika Services AG acceptance is based on the results of the peel-test according to the internal Sika Corporate Quality Procedure CQP 033-1 (based on the procedure described in Annex 2 of EAD 250005-00-0606) considering the conditioning stages given in the internal procedure CQP 034-1.

The assessment of the panels for the use as external wall cladding elements glued to the subframe is not covered, neither by the EAD 250005-00-0606, nor by this ETA. Therefore, the panels given in table A3.1 have not been assessed by ITeC for the use as external wall cladding elements glued to the subframe.

Table A3.1: Cladding panels accepted by SIKA SERVICES AG to be used with SikaTack® Panel-50 kit.

Generic type of substrate	Panel European technical reference	Company	Specific panel trade name
Ceramic tiles	EN 14411	Cosentino S.A.	Dekton
		Deutsche steinzeug Cremer & Breuer AG	KerAion
		Florim Ceramiche S.p.A.	FLORIM MAGNUM / FLORIM
		Iris Ceramica Group S.p.A	Procelain stoneware with: GHRTG44-H39 / GHST200-UB / GHRT131-UB / GHST200-KP
		Laminam S.p.A.	Laminam 3+ / Laminam 5+
		Levantina y Asociados de Minerales, S.A.	Techlam (with white mesh)
		Panariagroup Industrie Ceramiche S.p.A	Kerlite 5 PLUS / Kerlite 6 PLUS
Fibre-cement panels	EN 12467	Eternit Schweiz AG	Swisspearl Largo: Carat, Carat HR, Avera, Reflex, Incora, Texial, Vintago, Nobilis, Nobilis HR, Planea, Planea HR, Zenor, Design, Natura, R-Color, Terra
HPL laminates	EN 438-7	FunderMax GmbH	Max Exterior
		Resopal GmbH	Resoplan F
		Trespa International B.V.	Trespa Meteon Trespa Meteon FR-KR
Polymer composite panels	---	STENI AS	Steni Colour / Vision
		SYSTEMPOOL, S.A.	KRION K-Life
TMCP - Thin metal composite panels	EAD 210046-00-1201 & EOTA TR 038	3A Composites GmbH	Alucobond A2 / Alucobond Plus
		Alucoil, S.A.	Larson FR / Larson PE / Larson A2 / Larcore A2
		Elval Colour	Etalbond A2 / Etalbond FR
		Metawell GmbH	Metawell plus/A2
		Novelis Deutschland GmbH	Novelis FF2
		STAC, S.L.	Stacbond A2 / Stacbond FR / Stacbond PE